



# Clearview® COMPLETE HIV 1/2 Interpretation Quiz (A)

Write the Result on the line below each Test Device: Non-Reactive (NR); Reactive (R); Invalid (INV)

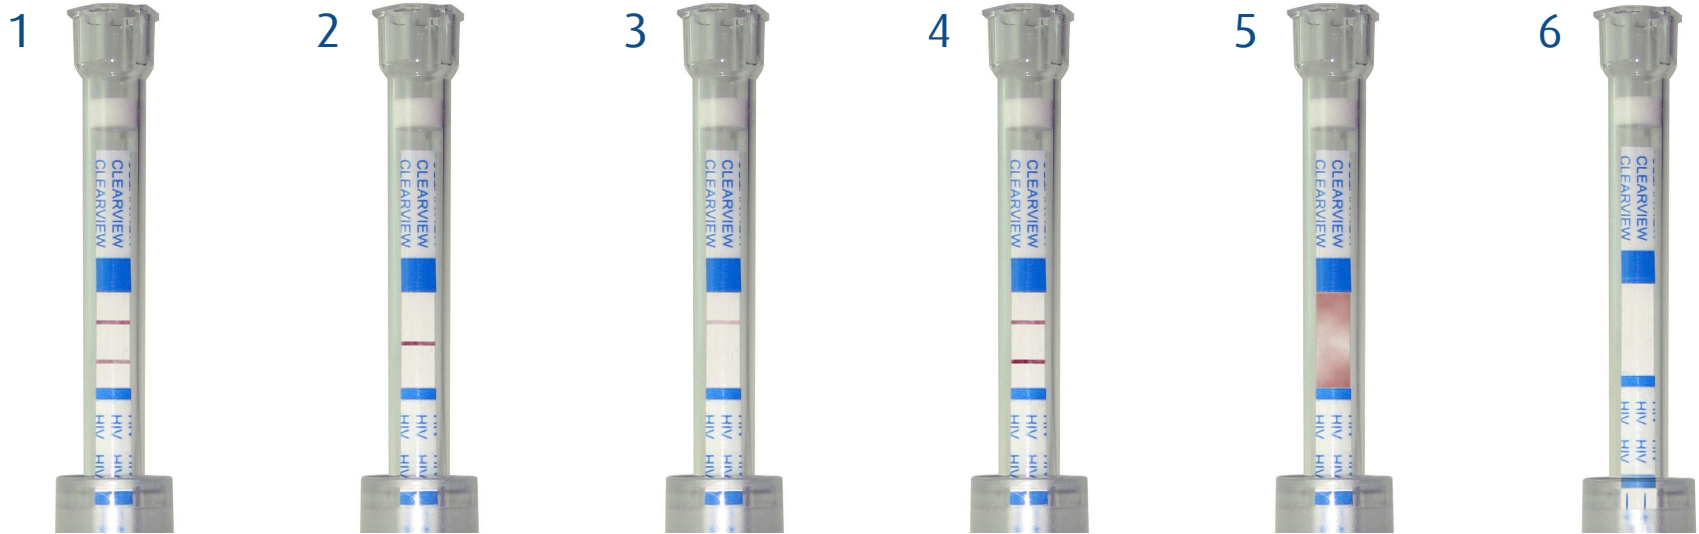

Result: \_\_\_\_\_ Result: \_\_\_\_\_ Result: \_\_\_\_\_ Result: \_\_\_\_\_ Result: \_\_\_\_\_ Result: \_\_\_\_\_

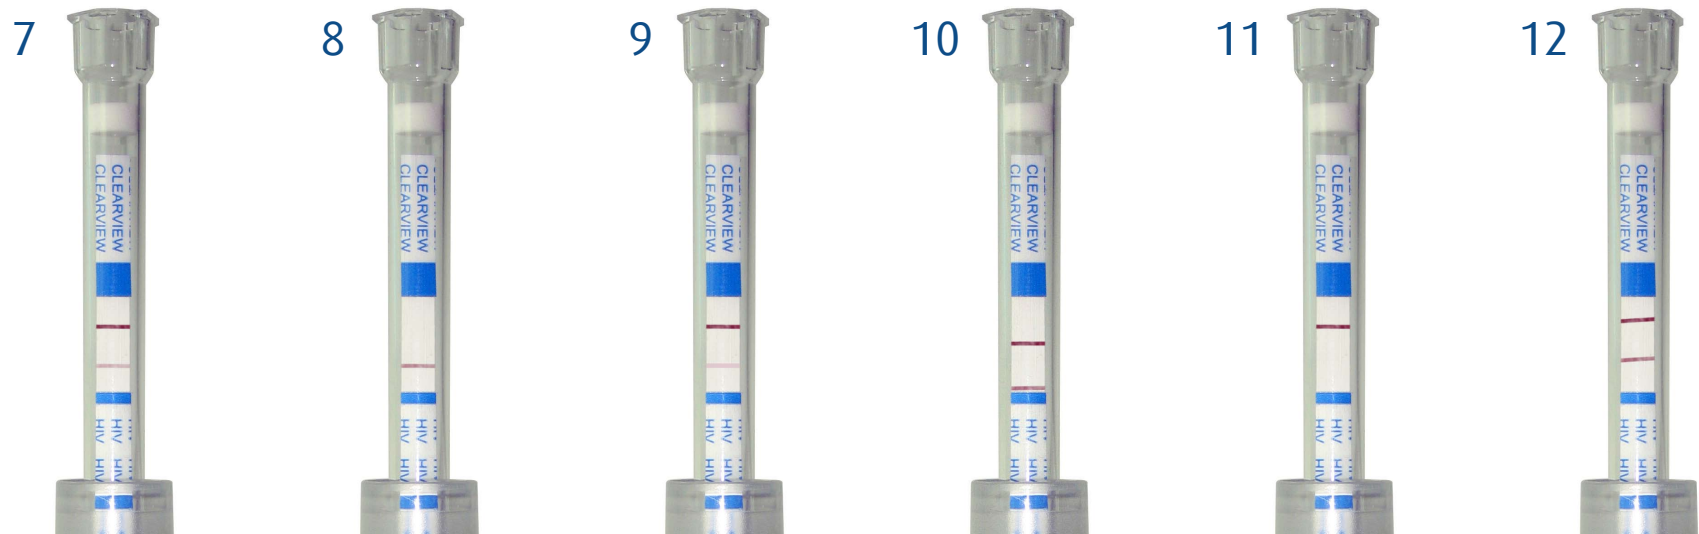

Result: \_\_\_\_\_ Result: \_\_\_\_\_ Result: \_\_\_\_\_ Result: \_\_\_\_\_ Result: \_\_\_\_\_ Result: \_\_\_\_\_

**For technical assistance, please call (877) 441-7440 • [www.invernessmedicalpd.com](http://www.invernessmedicalpd.com)**

ACOMP08QZ.1 ©2008 Inverness Medical. All rights reserved. All trademarks referenced are trademarks of their respective owners.

**FOR INFORMATION USE ONLY**, Not to be used for performing the assay, refer to the Clearview COMPLETE HIV 1/2 insert accompanying the test kit.